

NECESIDADES

Sistema de PA adecuado al recinto a sonorizar.

Imprescindible subgraves.

Mesa de mezcla digital Yamaha CL 5 o QL 5.


4 monitores de suelo.

2 sidefill.

9 pies de micros altos en buen estado.

Micro reserva inalámbrico de petaca Shure ULX P o superior.

Shure SM 58 para talkback (Ch16).

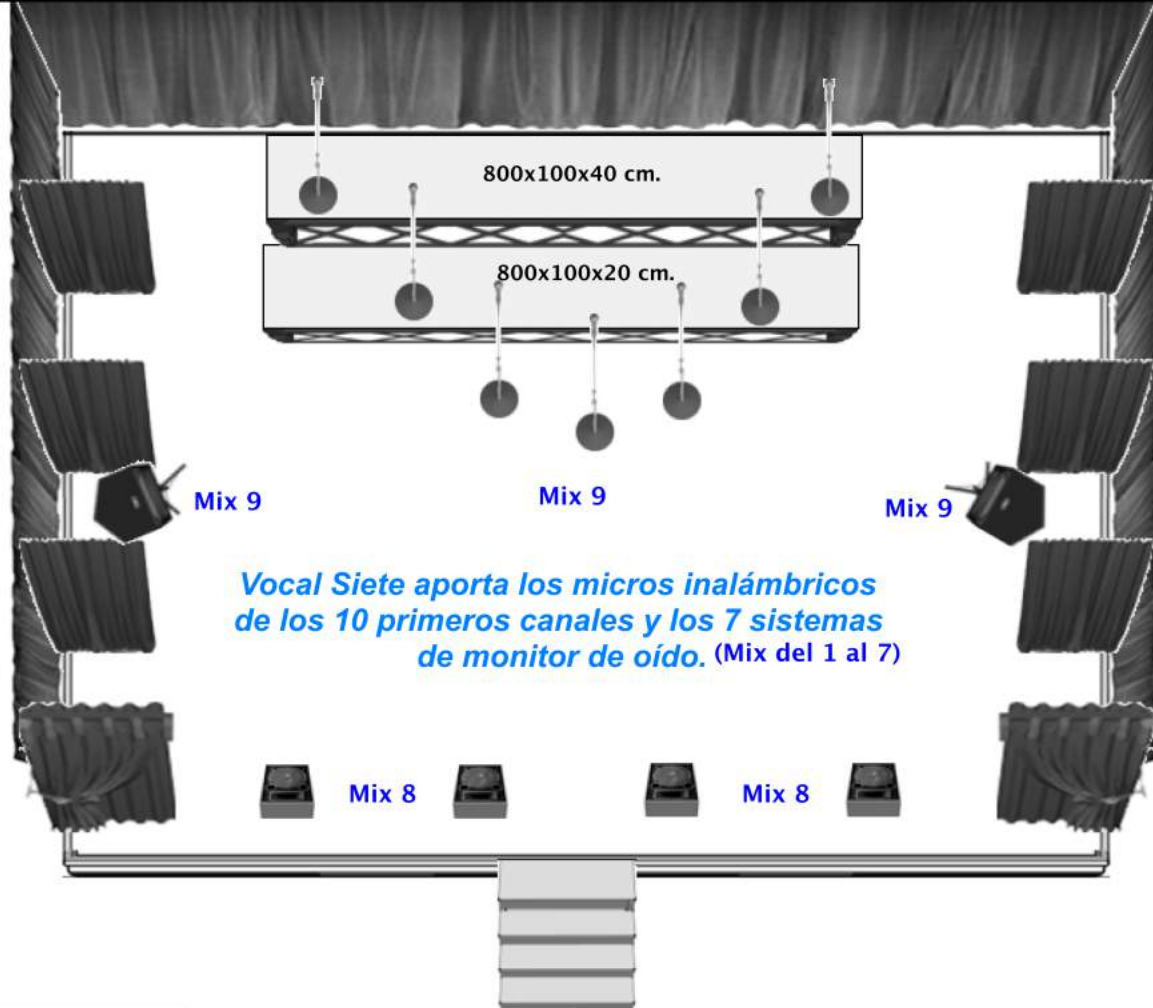

Lista de Canales

1. Shure UHF U4D Beta87
2. Shure UHF U4D Beta87
3. Shure UHF U4D Beta58
4. Shure UHF U4D Beta58
5. Shure UHF U4D Beta58
6. Shure UHF U4D Beta58
7. Shure UHF U4D Beta58
8. Shure UHF U4D Petaca
9. Shure UHF U4D Petaca
10. Shure UHF U4D Beta58
11. Shure inal. Petaca (Spare)



Contacto Técnico: Gustavo Sánchez....636 11 99 41

